A-A
F-40-00-01

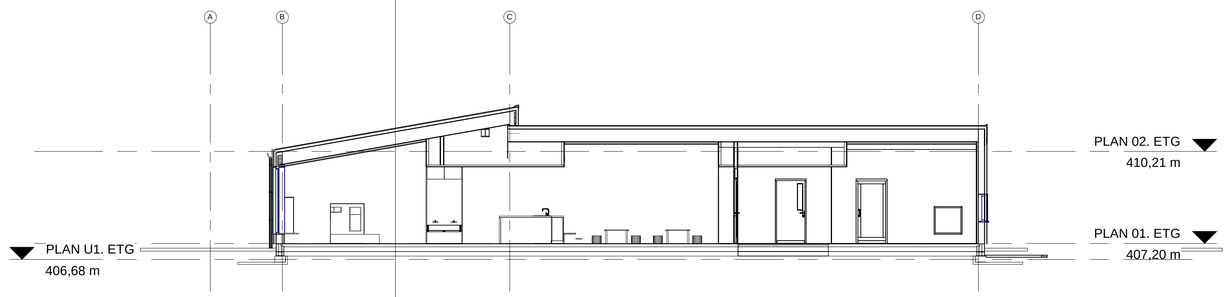

Bæreevne
Bæresystem, inkl. tak: R 15 [B 15]

Informasjon
Risikoklasse: 3

Brannklasse: 1

Bruttoareal: ca. 415 m2 (hovedbygg)

Personantall: ca. 40

Dører til rømingsvei skal ha fri bredde på minimum 0,86 meter (10X21M)

Branntekniske installasjoner
Heldekkende brannalarmanlegg (kategori 2), med akustiske og optiske signalgivere

Høytmonterte etterlysende markeringsskilt over rømningsdører og dører som inngår i fluktvei, samt nødbelysning

Annet
Tegningen er å anse som konsepttegning og skal leses sammen med brannkonseptet. Den har ikke status som byggetegning.

Revision	Date	Description	Prepared	DIC	Approved
F0 2	2019-04-08	Anbudsunderlag/for uavhengig kontroll	AAMHA	HEL	AAMHA
B0 1	2019-03-25	For informasjon/kommentar hos eksterne parter	AAMHA	HEL	AAMHA

This document has been prepared by Norconsult AS as part of the assignment stated below. Intellectual property rights belong to Norconsult AS. The document may only be used for the purpose stated in the contract between Norconsult AS and the client, and may not be copied or made available by other means or to a greater extent than the intended purpose requires.

Trysil Kommune

Scale SIZE (gjelder A1)
1:100

Jordet barnehage, prosj. nr. 06341
Branntegning - snitt B-B

Vedlegg til brannkonsept F-001

Norconsult

Project number	Document number	Revision
5187924	F-40-00-02	F02

2019-04-05 14:26:37 N:\5\5187924\RIB\Rev_Lokal\fil5187924 Jordet barnehage_RIB_aamha.rvt